
# Installation / User Manual

Photovoltaic Grid-connected Microinverter(Built-in WIFI-G3)

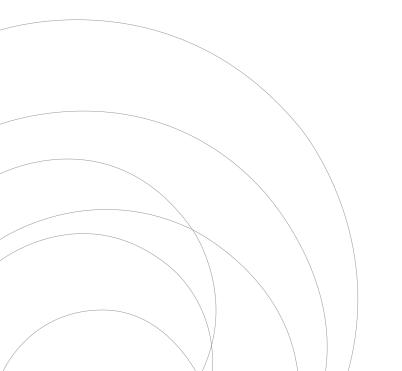

Ver:1.2, 2023.03.14

# Table of Contents

Important Safety Instructions	01-03
Safety Instructions	
Radio Interference Statement	
The Meaning of Symbols	
Microinverter System Introduction	03-05
Microinverters Maximize PV Energy Production	
More Reliable than Centralized or String Inverters	
Simple to Install	
Microinverter Introduction	05
Microinverter System Installation	06-10
Additional Installation Components	
Required Parts and Tools from You	
Parts list	
Installation Procedures	
Microinverter System Operating Instructions	10-11
Troubleshooting	11-13
Status Indications and Error Reporting	
Troubleshooting a Non-operating Microinverter	
Replacement	14
Technical Data	14-15
600/800/1000G3 Microinverter Datasheet	
Wiring Diagram	16-17
Monitoring Platform	18
How to Configure the Microinverter to the Router Via Web	19-22
How to connect in APP	23-27

# Important Safety Instructions

This manual contains important instructions to follow during installation and maintenance of the Photovoltaic Grid-connected Inverter(Microinverter).To reduce the risk of electrical shock and ensure the safe installation and operation of the Microinverter, the following symbols appear throughout this document to indicate dangerous conditions and important safety instructions.

Specifications subject to change without notice - please ensure you are using the latest manual found at the manufacturer website.

**WARNING:** This indicates a situation where failure to follow instructions may cause a serious hardware failure or personnel danger if not applied appropriately. Use extreme caution when performing this task.

**NOTE:** This indicates information that is important for optimized microinverter operation. Follow these instructions strictly.

## Safety Instructions

✓ DO NOT disconnect the PV module from the Microinverter without disconnecting the AC power.

 $\checkmark$  Only qualified professionals should install and/or replace the Microinverters.

✓ Perform all electrical installations in accordance with local electrical codes.

✓ Before installing or using the Microinverter, please read all instructions and cautionary markings in the technical documents and on the Microinverter system and the solar-array.

✓ Be aware that the body of the Microinverter is the heat sink and can reach a temperature of 80°C. To reduce risk of burns,do not touch the body of the Microinverter.

✓ DO NOT attempt to repair the Microinverter. If it fails, contact technical support to obtain an RMA number and start the replacement process. Damaging or opening the Microinverter will void the warranty.

#### ✓ Caution!

The external protective earthing conductor is connected to the inverter protective earthing terminal through AC connector.

When connecting, connect the AC connector first to ensure the inverter earthing then do the DC connections.

When disconnecting, disconnect the AC by opening the branch circuit breaker first

but maintain the protective earthing conductor in the branch circuit breaker connect to the inverter ,then disconnect the DC inputs.

✓ In any circumstance, do not connect DC input when AC connector is unplugged.

 $\checkmark$  Please install isolation switching devices on the AC side of the inverter.

## Radio Interference Statement


CE EMC Compliance: The equipment can comply with CE EMC, which are designed to protect against harmful interference in a residential installation. The equipment could radiate radio frequency energy and this might cause harmful interference to radio communications if not following the instructions when installing and using the equipment. But there is no guarantee that interference will not occur in a particular installation. If this equipment causes harmful interference to radio or television reception, the following measures might resolve the issues:

A) Relocate the receiving antenna and keep it well away from the equipment.

B) Consult the dealer or an experienced radio / TV technical for help.

Changes or modifications not expressly approved by the party responsible for compliance may void the user's authority to operate the equipment.

## The Meaning of Symbols

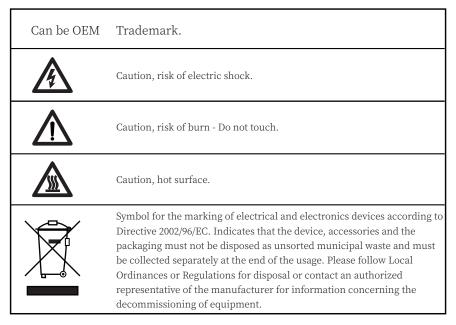

CE	CE mark is attached to the solar inverter to verify that the unit follows the provisions of the European Low Voltage and EMC Directives.
	Refer to the operating instructions.
Qualified personnel	Person adequately advised or supervised by an electrically skilled person to enable him or her to perceive risks and to avoid hazards which electricity can create. For the purpose of the safety information of this manual, a "qualified person" is someone who is familiar with requirements for safety, refrigeration system and EMC and is authorized to energize,ground, and tag equipment, systems, and circuits in accordance with established safety procedures. The inverter and endues system may only be commissioned and operated by qualified personnel.


# Microinverter System Introduction

The Microinverter is used in utility-interactive grid-tied applications, comprised of two key elements:

- · Microinverter
- · Router

This series microinverter has built-in WIFI module so it can communicate with router directly.

# 600 / 800 / 1000G3

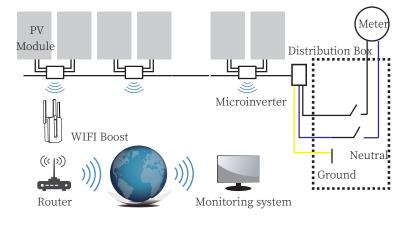

**NOTE:** If the wireless signal in the area where the microinverter is weak is weak, it is necessary to add a wifi signal booster at a suitable place between the router and the microinverter.

This integrated system improves safety; maximizes solar energy harvest; increases system reliability, and simplifies solar system design, installation, maintenance, and management.

## Microinverters Maximize PV Energy Production

Each PV module has individual Maximum Peak Power Tracking (MPPT) controls, which ensures that the maximum power is exported to the utility grid regardless of the performance of the other PV modules in the array.When PV modules in the array are affected by shade, dust, orientation,or any situation in which one module underperforms compared with the other units, the Microinverter ensures top performance from the array by maximizing the performance of each module within the array.

# More Reliable than Centralized or String Inverters

The distributed Microinverter system ensures that no single point of system failure exists across the PV system.Microinverters are designed to operate at full power at ambient outdoor temperatures of up to 149°F (65°C). The inverter housing is designed for outdoor installation and complies with the IP67 environmental enclosure rating.

## Simple to Install

You can install individual PV modules in any combination of Module quantity, orientation, different type and power rate The Ground wire (PE) of the AC cable is connected to the chassis inside of the Microinverter, potentially eliminating the installation of grounding wire (check local regulation).

Data collection adopts internal wifi, wireless router is needed near the microinverter. When complete the installation of microinverter, configure wireless router with internal wifi (refer to the wifi user manual). The data will be uploaded automatically. Users can monitor and manage the microinverter through corresponding website or APP.

# **Microinverter Introduction**

The Microinverters connect with the single-phase grid, and can also use multiple Microinverters in the form of single-phase grid to achieve three-phase grid. For more information, please see the Technical Data page (P15) of this manual.

Model Number	AC grid	Max. # Per branch	
SUN600G3-EU-230	50/60Hz,230V	8 for 25A breaker	
SUN800G3-EU-230	50/60Hz, 230V	6 for 25A breaker	
SUN1000G3-EU-230	50/60Hz, 230V	5 for 25A breaker	

## Microinverter System Installation

A PV system using Microinverters is simple to install. Each Microinverter easily mounts on the PV racking, directly beneath the PV module(s). Low voltage DC wires connect from the PV module directly to the Microinverter, eliminating the risk of high DC voltage.Installation MUST comply with local regulations and technical rules.

**WARNING:** Perform all electrical installations in accordance with local electrical codes.

- **WARNING:** Be aware that only qualified professionals should install and/or replace Microinverters.
- **WARNING:** Before installing or using an Microinverter, please read all instructions and warnings in the technical documents and on the Microinverter system itself as well as on the PV array.
- **WARNING:** Be aware that installation of this equipment includes the risk of electric shock.
- **NOTE:** Strongly recommend to install Surge protection Devices in the dedicated meter box.

### Additional Installation components

- AC Male and Female Interconnection Connectors (sold separately)
- Sealing end caps(sold separately)


## Required Parts and Tools from you

In addition to your PV array and its associated hardware, you will need the following items:

- An AC connection junction box
- · Mounting hardware suitable for module racking
- · Sockets and wrenches for mounting hardware
- · Continuous grounding conductor and grounding washers
- A Phillips screwdriver
- A torque wrench

## Parts list


Please check the following table, to see whether all the parts are included in the package:

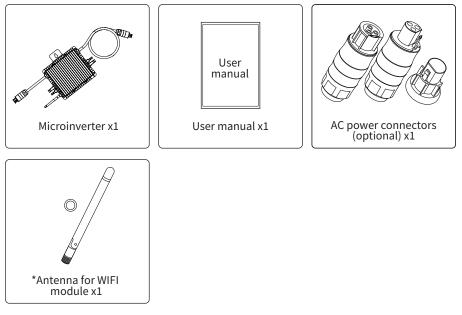

\* This antenna is for microinverter that has built-in wifi module.

## Installation Procedures

## Step 1 - Install the AC branch circuit junction box

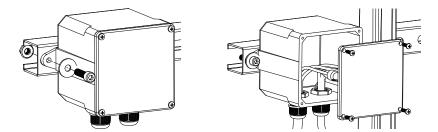


- a. Install an appropriate junction box at a suitable location on the PV racking system (typically at the end of a branch of modules).
- b. Connect the open wire end of the AC cable into the junction box using an appropriate gland or strain relief fitting.
- c. Wire the conductors of the AC(230/400Vac): L red; N black ;PE yellow green.
- d. Connect the AC branch circuit junction box to the point of utility Interconnection.

**WARNING:** Wiring colour code can be different according local regulation,check all the wires of the installation before connecting to the AC cable to be sure they match. Wrong cabling can damage irreparably the microinverters,such an issue is not covered by the warranty.

#### Step 2 - Attach the Microinverters to the racking or the PV module frame

- a. Mark the location of the Microinverter on the rack, with respect to the PV module junction box or any other obstructions.
- b. Mount one Microinverter at each of these locations using hardware recommended by your module racking vendor.

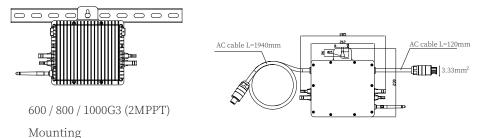


The AC wire on the micro inverter is a TC-ER wire with a wire cross-section area of 3.33mm<sup>2</sup>.

**WARNING:** Prior to installing any of the microinverters, verify that the utility voltage at the point of common connection matches the voltage rating on microinverter label.

**WARNING:** Do not place the inverters (including DC and AC connectors) where exposed to the sun, rain or snow, even gap between modules. Allow a minimum of 3/4 (1.5cm.) between the roof and the bottom of the Microinverter to allow proper air flow.

#### Step 3 - Connect the microinverters in parallel

- a. Check the Microinverter technical data page 5 for the maximum allowable number of Microinverters on each AC branch circuit.
- b. Plug the male AC connector of the Microinverter into the female connector to get it connected.AC connector interface as follows.

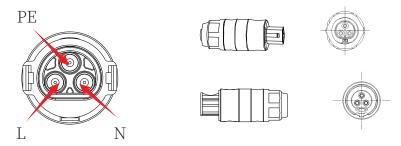


**WARNING:** DO NOT exceed maximum number of Microinverters in an AC branch circuit, as displayed on the page 5 of this manual.

Step 4 - Install an AC cable protective end cap at the end of AC cable



Step 5 - Connect Microinverter to the PV Modules

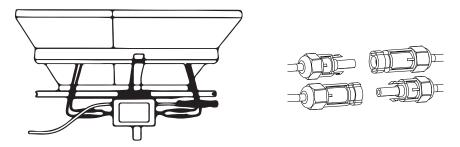

**NOTE:**When plugging in the DC cables, if AC already available,the Microinverter should immediately blink red light and will start work within the setting time (default 60 seconds). If AC is not available,the red light will blink 3 times quickly and repeat after one second until AC is connected.

# **Microinverter System Operating Instructions**

## To operate the microinverter PV system:

- 1. Turn ON the AC circuit breaker on each microinverter AC branch circuit.
- 2. Turn ON the main utility-grid AC circuit breaker. Your system will start producing power after a one-minute waiting time.

- 3. The units should start blinking red one minutes after turning on the AC circuit breaker. Then blue led blinking. This means they are producing power normally, the faster blinking of the blue led means more power generated.
- 4. Configure the internal wifi module according to its user manual.
- 5. The Microinverters will start to send performance data over wifi module to the network every 5 minutes. It enables customers to monitor performance data of each microinverter through website and APP.

**NOTE:** When AC power is applied but the microinverter not started up, about 0.1A current and 25VA(W) power for each microinverter may be measured by a power meter. This power is reactive power,not consume from utility grid.

# Troubleshooting

Qualified personnel can use the following troubleshooting steps if the PV system does not operate correctly:

## Status Indications and Error Reporting

Start up LED

One minute after DC power is first applied to the microinverter, one short red blinks indicate a successful microinverter startup sequence, be equal or greater than two short red blinks after DC power is first applied to the microinverter indicate a failure during microinverter setup.

Operation LED

Flashing Slow Blue	- Producing small power
Flashing Fast Blue	- Producing big power
Flashing Red	- Not producing power
Red blinking two times	- AC low-voltage or high-voltage
Red blinking three time	s - Grid failure

#### GFDI Error

A four time red LED indicates the Microinverter has detected a Ground Fault Detector Interrupter (GFDI) error in the PV system. Unless the GFDI error has been cleared, the LED will remain four times blinking.

Other Faults

All other faults can be reported to the website and APP.

**WARNING:** Never disconnect the DC wire connectors under load. Ensure that no current is flowing in the DC wires prior to disconnecting. An opaque covering may be used to cover the module prior to disconnecting the module.

## Troubleshooting a non-operating Microinverter

There are two possible overall areas of trouble:

- A. The Microinverter itself may be having problems.
- B. The Microinverter itself is working fine but the communication between microinverter and network has problem. The items below refer to Microinverter issues, not communicat -ion issues:

One quick way to tell whether the issue is the Microinverter or the communication problem:

 Diagnosing from the Microinverter: A red light–either blinking or solid on the Microinverter, or no light at all means it is definitely the Microinverter problem.
 0 watts, or 2 watts: Possibly a Microinverter problem

- 2. Diagnosing from the network:
  - a. No-Data-Display: The website and APP don't display any data.Check the network configuration.
  - b. Only display microinverter is online but no data. This maybe because server is updating.

# To troubleshoot a non-operating Microinverter, Follow the steps below in order:

- 1. Verify the utility voltage and frequency are within ranges shown in the Technical Data section of this manual.
- 2. Check the connection to the utility grid.Disconnect AC firstly,then disconnect DC and make sure the utility grid voltage can be measured at AC connector. Never disconnect the DC wires while the microinverter is producing power. Re-connect the DC module connectors and watch for three short LED flashes.
- 3. Check the AC branch circuit interconnection between all the microinverters. Verify each inverter is energized by the utility grid as described in the previous step.
- 4. Make sure that any AC breaker are functioning properly and are closed.
- 5. Check the DC connections between the microinverter and the PV module.
- 6. Verify the PV module DC voltage is within the allowable range shown in the Technical Data of this manual.
- 7. If the problem still persists, please contact technical support.

**WARNING:** Do not attempt to repair the microinverter. If troubleshooting methods fail, please call for Technical Support

# Replacement

## Follow the procedure to replace a failed Microinverter

- A. Disconnect the Microinverter from the PV Module, in the order shown below:
  - 1. Disconnect the AC by turning off the branch circuit breaker.
  - 2. Disconnect the AC connector of the microinverter.
  - 3. Cover the module with an opaque cover.
  - 4. Disconnect the PV module DC wire connectors from the Microinverter.
  - 5. Remove the Microinverter from the PV array racking.
- B. Install a replaced Microinverter to the bracket then remove the opaque cover. Remember to observe the flashing LED light as soon as the new Microinverter is plugged into the DC cables.
- C. Connect the AC cable of the replacement Microinverter.

# Technical Data

**WARNING:** Be sure to verify the voltage and current specifications of your PV module match with those of the Microinverter. Please refer to the datasheet or user manual.

**WARNING:** You must match the DC operating voltage range of the PV module with the allowable input voltage range of the Microinverter.

**WARNING:** The maximum open circuit voltage of the PV module must not exceed the specified maximum input voltage of the inverter.

# 600G3/800G3/1000G3 Microinverter Datasheet

Model	SUN600G3- EU-230	SUN800G3- EU-230	SUN1000G3- EU-230
Input Data (DC)			
Recommended input power(STC)	210-420W(2 Piece)	210-500W(2 Piece)	210-600W(2 Piece)
Maximum input DC voltage		60V	
MPPT Voltage Range		25~55V	
MPPT Full Power Voltage Range(V)	30V-55V	33V-55V	40V-55V
Min.DC input voltage(V)		20V	
Max DC short circuit current		19.5Ax2	
Max input current		13Ax2	
Output Data (AC)			
Rated output Power	600W	800W	1000W
Max.AC Output Power	600W	800W	1000W
Rated AC output current	2.7/2.6A	3.6/3.5A	4.5/4.4A
Max.AC Output Current	2.7/2.6A	3.6/3.5A	4.5/4.4A
Nominal voltage / range	220V/0.85U	n-1.1Un 230V/0.8	5Un-1.1Un
Nominal frequency		50/60Hz	
Extended frequency / range		45~55Hz / 55~65Hz	
Power factor		1	
Maximum unit per branch	8	6	5
Max. allowed altitude operating		<4000m	
Max.inverter backfeed current to the array		0A	
Max output fault current		10A	
Efficiency			
CEC weighted efficiency		95%	
Peak inverter efficiency		96.5%	
Static MPPT efficiency		99%	
Night time power consumption		50mW	
Mechanical Data			
Ambient temperature range		-40 °C ~ 65 °C	
Dimensions(W×H×D mm)	212W×230H×40D	(Without mounting	bracket and cable)
Weight (kg)		3.15	
Cooling		Natural cooling	
Enclosure environmental rating		IP67	
Protective class		Class I	
Features			
Compatibility	Compa	tible with 60,72 cell PV r	nodules
Communication		WiFi / Zigbee	
Compliance	EN50549,VDE01	26,VDE4105,IEC621	09,CE,INMETRO
Warranty		10 Years	


# Wiring Diagram MAX 8 SUN600G3-EU-230 per Branch MAX 6 SUN800G3-EU-230 per Branch MAX 5 SUN1000G3-EU-230 per Branch Sample Wiring Diagram Three Phase Ę F 600/800/1000G3 (2MPPT) F WIFI Boost a S H RED L BLACK N YELLOW PE JUNCTION BOX Ŀ

Monitoring system

Router

GROUND

meter

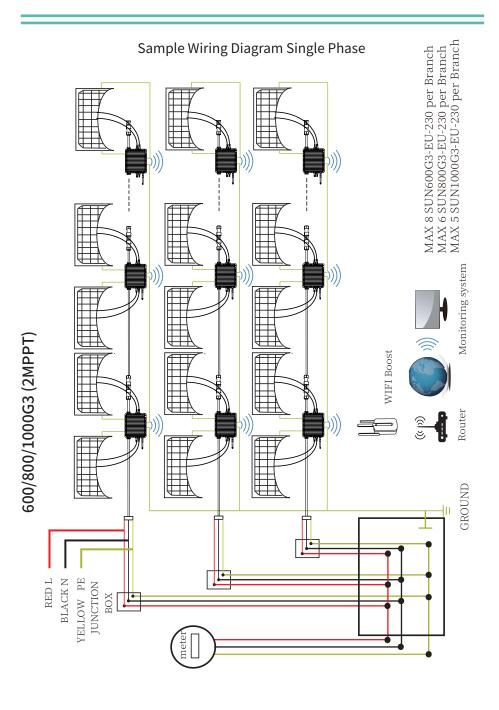

# **Monitoring Platform**

This series microinverter has built-in WIFI modular which is able to connect router directly. For WIFI configuration, please check the manual of "Built-in WIFI modular microinverter WIFI configuration Manual"

Web monitoring address: *https://pro.solarmanpv.com;* (for Solarman distributor account) *https://home.solarmanpv.com* (for Solarman end user account)

For mobile phone monitoring system, scan the QR code to download the APP. Also you can find it by searching "solarman business" in App store or Google Play store, and this App is for distributor/installer.

Find it by searching "solarman smart" in App store or Google Play store and choose "solarman smart", this app is for plant owner.



SOLARMAN Smart for end user



SOLARMAN Business for distributor/installer

# How to Configure the Microinverter to the Router Via Web

1. Turn on the wireless network of your PC or smartphone.

2. Select logger network (network name: AP\_SN) and connect. The default password is 12345678.



Microinverter SN: 2208314002 Built-in datalogger :1704013242

3. Open a browser and enter 10.10.100.254. Both username and password are "admin". (Recommended browser: IE 8+, Chrome 15+, Firefox 10 + ).

0 10.10.100.254		
Status Wizard Quick Set Advanced Upgrade Restart Reset	http://10.10.100.254 Please input username and password."USER LOGIN"         Username:       admin         Password:       ••••••         Sure       Cancel	Help The setup wizard will assist you to complete the device setting within one minute.

4. Browser jumps to "Status" page, the basic information is listed there.

	- Inverter information		Help
Wizard	Inverter serial number		
Quick Set	Firmware version(main)		The device can be used as
Advanced	Firmware version(slave)		a wireless access point(AP
Upgrade	Inverter model		mode) to facilitata users to configure the device, or it
Restart	Rated power	W	can also be used as a wireless information terminal
Reset	Current power	W	(STA mode) to connect the remote server via wireless
Reset	Yield today	kWh	router.
	Current power	kWh	Status of remote server
	Alerts		Not connected: Connection
	Last updated		to server failed last time. If under such status, please
	- Device information Device serial number	1704013242	(1)check the device information to see whether IP address is obtained or
	Firmware version	LSW3_14_FFFF_1.0.23	not; (2)check if the router is
	Wireless AP mode	Enable	connected to internet or not; (2)check if a firewall is set
	Wireless AP mode SSID	Enable AP_1704013242	(3)check if a firewall is set on the router or not;
			(3)check if a firewall is set on the router or not;
	SSID	AP_1704013242	(3)check if a firewall is set
	SSID IP address	AP_1704013242 10.10.100.254	<ul> <li>(3)check if a firewall is set on the router or not;</li> <li>Connected: connection to</li> </ul>
	SSID IP address MAC address Wireless STA mode Router SSID	AP_1704013242 10.10.100.254 8C:D8:B3:71:8D:B0	(3)check if a firewall is set on the router or not; • Connected: connection to server successful last time; • Unknown: No connection to server.Please check
	SSID IP address MAC address Wireless STA mode	AP_1704013242 10.10.100.254 8C:D8:B3:71:8D:B0	<ul> <li>(3)check if a firewall is set on the router or not;</li> <li>Connected: connection to server successful last time;</li> <li>Unknown: No connection</li> </ul>
	SSID IP address MAC address Wireless STA mode Router SSID Signal Quality IP address	AP_1704013242 10.10.100.254 8C:D8:B3:71:8D:B0	(3)check if a firewall is set on the router or not; • Connected: connection to server successful last time; • Unknown: No connection to server.Please check
	SSID IP address MAC address Wireless STA mode Router SSID Signal Quality	AP_1704013242 10.10.100.254 8C:D8:B3:71:8D:B0	(3)check if a firewall is set on the router or not; • Connected: connection to server successful last time; • Unknown: No connection to server.Please check
	SSID IP address MAC address Wireless STA mode Router SSID Signal Quality IP address	AP_1704013242 10.10.100.254 8C:D8:B3:71:8D:B0	(3)check if a firewall is set on the router or not; • Connected: connection to server successful last time; • Unknown: No connection to server.Please check

5. Turn to "Wizard" page, click "Refresh" to search the wireless network. Select the target network and click "Next" .

Wizard	IE-2.4G-TEST	54:A7:3:70:99:13	82	1	^	
Quick Set		0:BE:D5:20:B8:2C	80	1	-	
	O AP_1753738492	30:EA:E7:36:B:36	78	2		The setup wizard will assist
Advanced	O IGEN_office_2.4G	0:BE:D5:20:B8:2C	76	1		you to complete the device
Upgrade	OIGENTEST	E8:65:D4:F2:15:B8	74	6		setting within one minute.
opgrade	ŏ	90:5D:7C:97:95:29	74	1		
Restart	O IGEN_office_2.4G	90:5D:7C:97:95:27	72	1		
Reset	0	90:5D:7C:97:C9:E5	72	1		
Reset	O AP_1719065936	30:EA:E7:36:CF:B2	70	1		
	O IGEN_office_2.4G	90:5D:7C:97:C9:E3	70	1		
	○ TESR+ <sup>400</sup> ?=,;	4A:E:EC:9E:C3:3E	70	11		
	O IGEN_office_2.4G	0:BE:D5:20:B7:EE	66	11		
	connection may be unstable shorten the distance betwee	ted WiFi network is lower tha , please select other available n the device and router.				
		, please select other available		vork or		
	shorten the distance betwee Add wireless network manua Network name (SSID) (Note:case sensitive)	, please select other available n the device and router.	netv	vork or	_	


6. Enter the password and click Next.

Status		
Wizard		Help
Quick Set	Please fill in the following inf	ormation:
Advanced		Most systems support the function of DHCP to obtain
Upgrade		IP address automatically. Please select disable and
Restart	Password(8-64 bytes) (Note: case sensitive)	add it manually if your rou does not support such
Reset		Show Password
	Obtain an IP address automatically	Enable ~
	IP address	
	Subnet mask	
	Gateway address	
	DNS server address	
		Back Next
	1 2 3	3 4

7. Users can select any options below to enhance the security and click Next.

Wizard		Help
Quick Set	Enhance Security	Change the encryption
Advanced		mode for AP
Upgrade	You can enhance your system security by choosing the following methods	AP network, you will need t enter the password to
Restart	Hide AP	connect to AP.
Reset	Change the encryption mode for AP	Change the user name and password for Web server
	Change the user name and password for Web server	If you change the username and password for the web server, you will need to enter
		the new username and password to get access to the setting page.
	Back	
	1 2 3 4	

8. If the setup is successful, the following page will pop up and click OK to reboot the micro inverter.

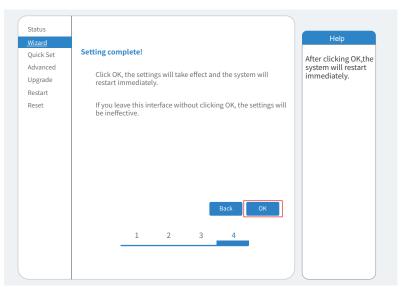

9. Connect to loggeer AP network again, then log in to 10.10.100.254 by Browser, and check the system info of "Status" page. After the network setting is done, the remote server A or B should be "connected".

Status			
Vizard	Inverter information  Inverter serial number		Help
Duick Set			
dvanced	Firmware version(main) Firmware version(slave)		The device can be used as a wireless access point(AP
avancea	Inverter model		mode) to facilitata users to
grade			configure the device, or it can also be used as a
tart	Rated power	W	wireless information termin (STA mode) to connect the
et	Current power	W	remote server via wireless
	Yield today	kWh	router.
	Current power	kWh	Status of remote server
	Alerts		<ul> <li>Not connected: Connecti to server failed last time.</li> </ul>
	Last updated		If under such status, please
	- Device information		check the issues as follows (1)check the device information to see whethe
	Device serial number	1704013242	IP address is obtained or
	Firmware version	LSW3_14_FFFF_1.0.23	not; (2)check if the router is
	Wireless AP mode	Disable	connected to internet or n (3) check if a firewall is set
	SSID		on the router or not;
	IP address		
	MAC address		<ul> <li>Connected: connection to server successful last tim</li> </ul>
	Wireless STA mode	Enable	Allakaowa: No connection
	Wireless STA mode Router SSID	Enable IE-2.4G-TEST	to server. Please check
	Router SSID	IE-2.4G-TEST	to server. Please check
	Router SSID Signal Quality	IE-2.4G-TEST 100%	to server. Please check
	Router SSID Signal Quality IP address	IE-2.4G-TEST 100% 172.16.30.247	

10. If both remote server A and B are "Not connected", please refresh the page or repeat the previous steps. If the "Signal Quality" is lower than 40%, please move your Router closer to the Microinverter.

## How to connect in APP

#### 1. Registration

Open the app of SOLARMAN Smart and register an account.

Click "Register" and create your account here.

English∽	← Register
SOLARMAN Smart	Phone Number E-mail
E-mail Phone Number Username	
E-mail E-mail	E-mail Please enter E-mail
Password password	Verification Code Please enter verification code
	Password Password
Log In	Password length must be greater than 6bits
Register Forgot Password?	

#### 2. Create a Plant


Click "Add Now" to create your plant. Please fill in plant basic info and other info here.

MY Plants	+	< Basic Info	Plant Details
		Plant Name	Demo plant -Commercial >
		Plant Loc	Zhwjiang yuyao 🗦
111		Time Zone	((UTC+08:00)Beijing,Chongqing, HongKong,Urumqi)
		Creation Date	2019-05-04 >
YOU have no plants for now.		Founder	Clavin >
		System Info	
Add Now		Plant Type	Residential Rooftop >
		System Type	All on Grid >
		Installed Capaci	ty(kWp) 18350 >
plant Me			Finish

### 3. Add a Logger

Optional 1: Enter the logger SN manually. Optional 2: Click the icon in the right and scan the QR code to enter logger SN.

You can find logger SN on the carton packaging or on the logger body.

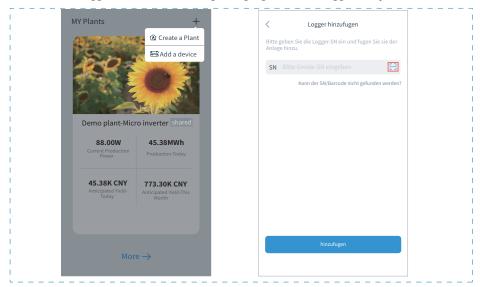

#### 4. Network Configuration

After the logger is added, please configure the network to ensure normal operation. Go to "Plant Details"-"Device List", find the target SN and click " Device Networking".

Cogger     Nerrer       No. of Connections: 2       Logger       Neter       Module       Logger       Nodule         Logger       Select associated device       Device Networking       Device Networking       Device Networking		
Logger     Normal       SN:123341245     Device Networking       Meter     Select associated device     Device Networking       Module     Logger     Office       SN:136689995     Office     SN:136689995	$\leftarrow$	Device Details +
Logger     SN:123341245       Meter     Select associated device       Module     Logger       SN:136689995     Office	Inverter	NO. of Connections: 2
Module Logger office SN:136689995	Logger	
Logger Office SN:136689995	Meter	Select associated device
	Module	SN:136689995

#### Step 1: Confirm Wi-Fi Info

Please make sure your phone has connected to the right WiFi network. And click "Start to configure".

$\triangle$	Notice: 5G WiFi is not supported . 5 Special characters (e.g. , ; '' =""`) in router name and password are not supported.						
	← SN:2312423						
	Password						
	£ ****						
     	5G frequency band is not supprted. Please connect to 2.4G frequency band. Start to configure						

#### Step 2: Connect to AP network

Click " Go to connect" and find the right "AP\_XXXXXXXXX" network (XXXXXXXXX refers to logger SN).

The password is required, please input "12345678".

Go back to SOLARMAN Smart APP after connecting to AP network.

settings WLAN		Go to WLAN Setting and cor following network manually	nect the
VLAN	â 🗢 i		
YNETWORKS		A	· @
ndroid	<b>?</b> ()	AP_622602179	
hinaNet	<b>e                                    </b>	комк 55 🔒 🛱 комк налах 🔒 🛱	
P_622602179	<b>?</b> ()	(	
YH123	<b>a </b> <del>?</del> ()		
GWN-5G	<b>a </b> <del>?</del> ()	← AP_622602179	
HER NETWORKS		Password	Ø
ct-blue	<b>?</b> ()	Show advanced options	
hinaNet-igen	â 🗢 ()		

#### Step 3: Auto Configuration

Please wait for a while to complete the configuration. Then system will turn to the following page.

Click "Done" to check plant data. (Usually, the data will be updated in 10 mins)

